


# Test Report

Type: JST110KZN Pole: 4 Output: 15 Frequency: 50  
 Phase: 3  $\phi$  Voltage: 380 Test Date: 2004/3/15

PUMP Performance Curve

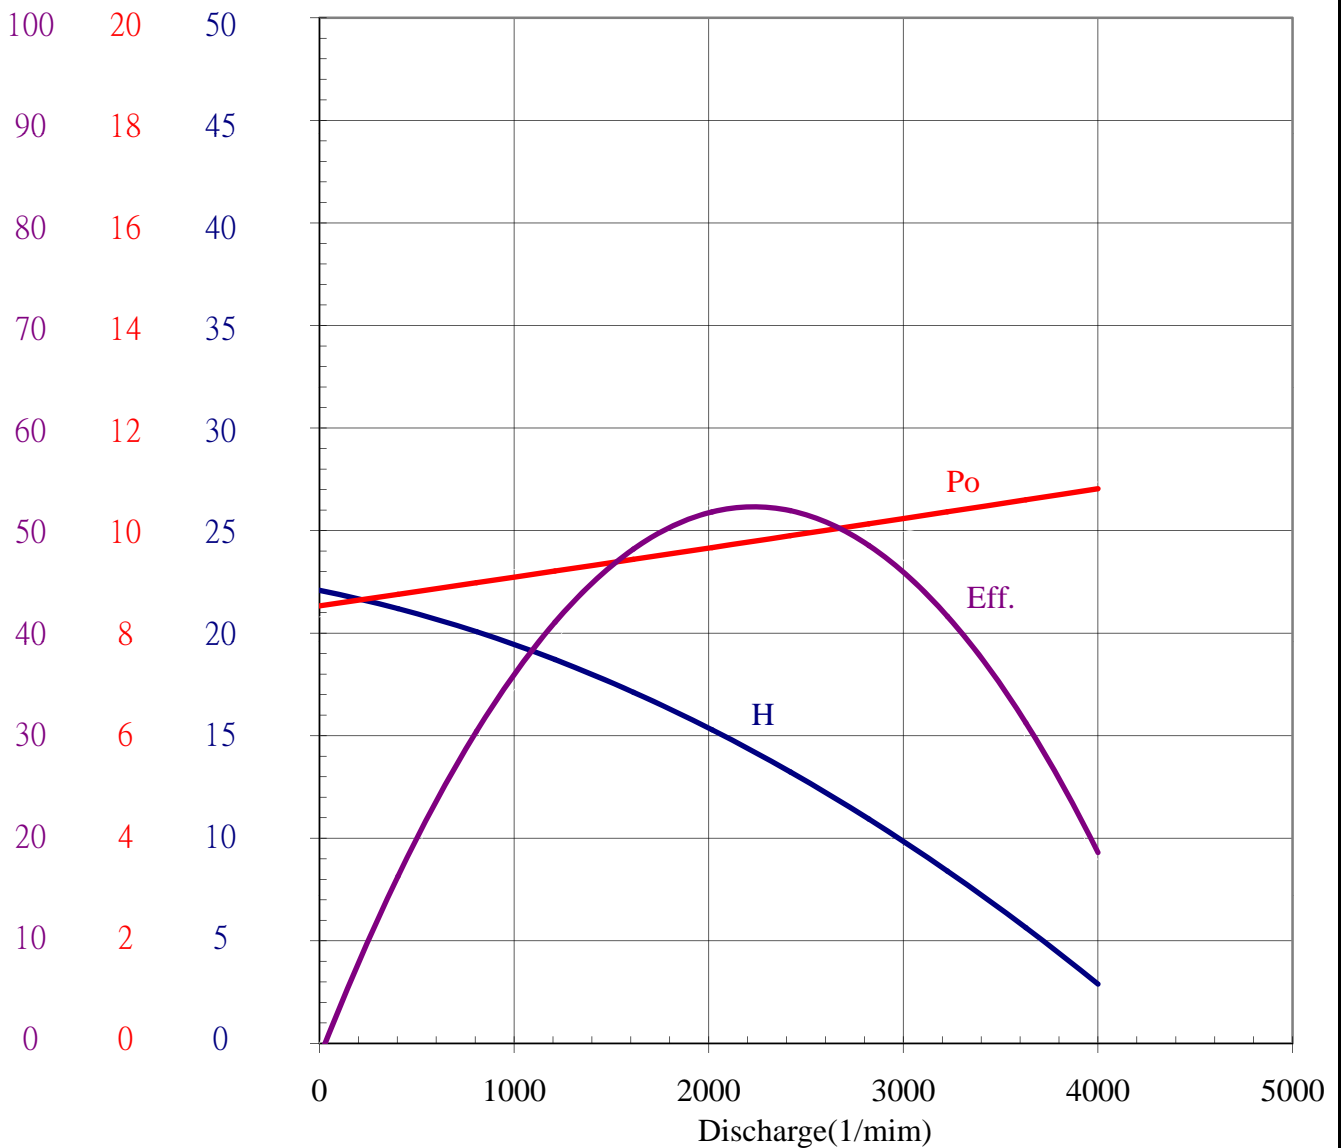

Effic- Shaft Manom-  
 ient Output etric  
 % Po(KW) H (M)

